
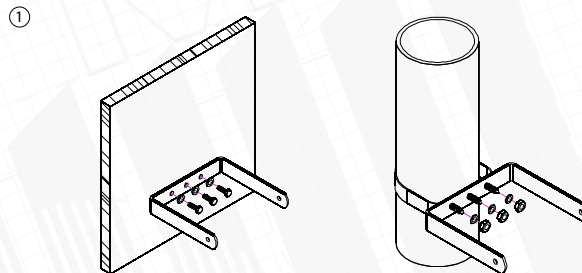



SP 10EN Loudspeaker for voice alarm systems

AMC 2016 - 004
Revision 2019-03-20


EN54-24:2008
1438-CPR-0507
ISSUE DATE: 17
TYPE B

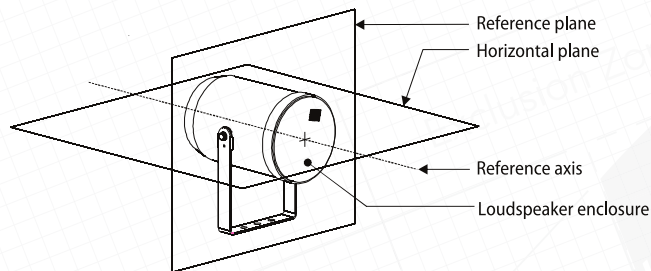

Remove the "U" bracket from the speaker. Drill the mounting location holes for the unit in line with the "U" bracket (2 holes 30 mm apart) in the surface where the loudspeaker is to be located.

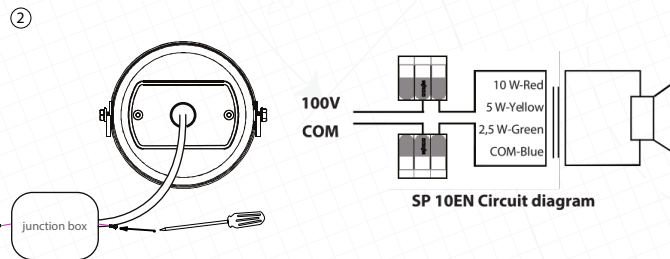

Connect speaker cable to audio line inside the electrical junction box using block terminal. The unused power tap should be isolated or fixed to free terminal block pin. Speaker cable colours and power: Blue – COM, Green – 2.5 W, Yellow – 5 W, Red – 10 W. Junction box and terminal are not supplied.

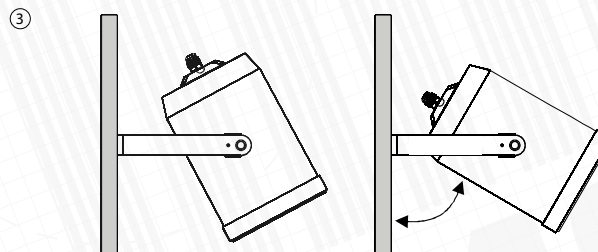

Re-fit the speaker to the "U" bracket. Position the speaker to the desired angle, then tighten the fixings to secure in place. Before connecting the speaker circuit to the power amplifier we strongly advise that the impedance of the circuit is checked to ensure it is fault-free in order to prevent damage to the speaker and / or amplification.